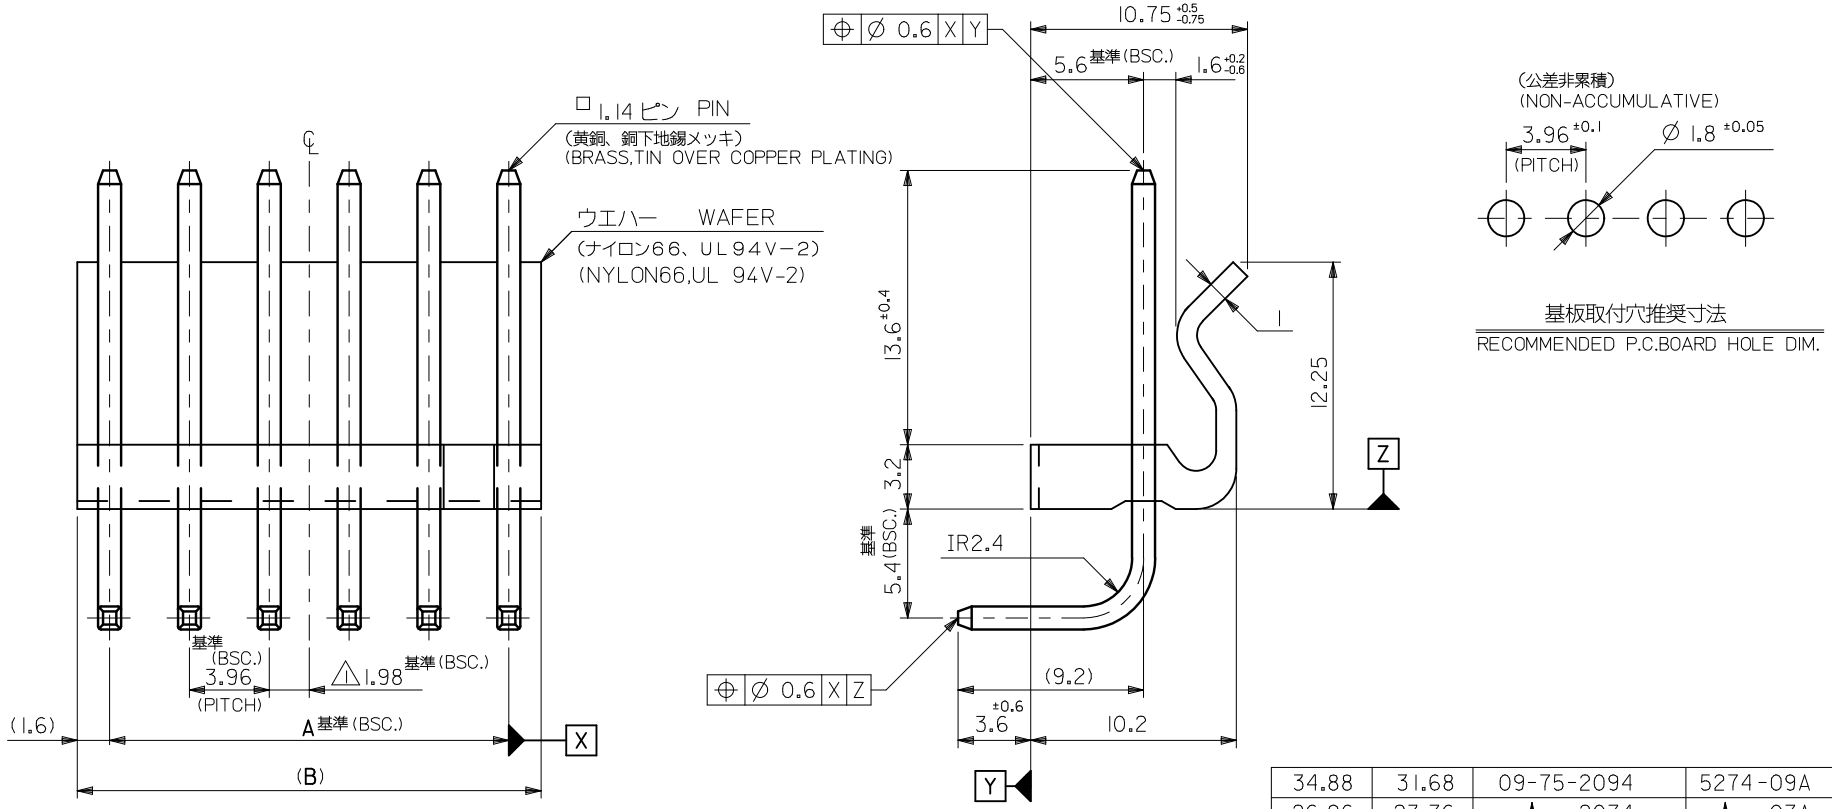


(公差非累積)
(NON-ACCUMULATIVE)

基板取付穴推奨寸法
RECOMMENDED P.C.BOARD HOLE DIM.

34.88	31.68	09-75-2094	5274-09A	9
26.96	23.76	-2074	-07A	7
23	19.8	-2064	-06A	6
19.04	15.84	-2054	-05A	5
15.08	11.88	-2044	-04A	4
11.12	7.92	-2034	-03A	3
7.16	3.96	09-75-2024	5274-02A	2
B	A	オーダー番号 (EDP NO.) ORDER NO. (EDP NO.)	ENG. NO.	極数 CKTS

注記
NOTE

⚠ 全極数が偶数の場合にのみ適用。
TO BE APPLIED ONLY WHEN ALL CKTS. ARE EVEN.

REVISED
EC NO: J2009-2884 2009/06/24
DRWN:YSHIBATA 2010/03/15
CH'KD:THARUYAMA 2010/03/15
APPR:NUKITA 2010/03/15
DESCRIPTION
D
REV

GENERAL TOLERANCES (UNLESS SPECIFIED)

10 UNDER	±0.2
10 OVER 30 UNDER	±0.25
30 OVER	±0.3
ANGULAR	±3 °

DRAFT WHERE APPLICABLE MUST REMAIN WITHIN DIMENSIONS

DIMENSION STYLE: MM ONLY
SCALE: 4:1
DESIGN UNITS: METRIC
THIRD ANGLE PROJECTION

DRAWN BY: H.HIRAMATO DATE: 1991/05/13
CHECKED BY: M.FUKUSHIMA DATE: 1991/05/15
APPROVED BY: M.ENOMOTO DATE: 1991/05/15

TITLE: KK 3.96 WAFER ASS'Y RIGHT ANGLE WITH LOCK

MOLEX INCORPORATED

MATERIAL NO.: SEE TABLE
DOCUMENT NO.: SD-5274-001
SHEET NO.: 1 OF 1
SIZE: A3

THIS DRAWING CONTAINS INFORMATION THAT IS PROPRIETARY TO MOLEX INCORPORATED AND SHOULD NOT BE USED WITHOUT WRITTEN PERMISSION